


REV.	CAT. NO.	SUFFIX	STUD HOLE		D	APPROX. WEIGHT	STRIP			
	CAI. NO.			Α	В	С	D	Е	(LB)	LENGTH
08	BLU-1/0S19	S19	1/4	2.05	.87	.87	.12	.73	0.053	
12	BLU-1/OS	S	5/16	2.05	.87	.88	.12	.73	0.052	1.00
13	BLU-1/0S1	\$1	3/8	2.05	.87	.88	.12	.73	0.051	1.00
07	BLU-1/0S20	S20	1/2	2.25	1.06	.87	.12	.73	0.053	

INK STAMP REFERENCE






USE BELOW OPTIONAL SUFFIXES FOR ALTERNATE LUG CONFIGURATIONS: -45 FOR 45° BENT PAD -90 FOR 90° BENT PAD

-FL FOR FLARED BARREL ENTRY

-U FOR UNDRILLED PAD EXAMPLE: BLU-1/0S19-FL

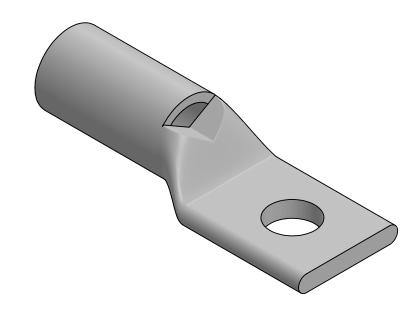

NOTES:

- 1. ALL DIMENSIONS IN INCHES UNLESS OTHERWISE SPECIFIED
- 2. SEE INSTALLATION SHEET FOR WIRE SIZE AND TOOLING RECOMMENDATIONS
- 3. TIN-PLATED TO INHIBIT CORROSION
- 4. RATED FOR COPPER CONDUCTORS ONLY
- 5. BEVELED ENTRY FOR EASY CABLE INSERTION
- 6. INSPECTION WINDOW TO ENSURE FULL CABLE INSERTION
- 7. CONNECTORS ARE SUITABLE FOR VOLTAGES UP TO 35 KV
- 8. FOR APPLICATIONS GREATER THAN 2000 VOLTS, CONSULT CABLE MANUFACTURER FOR VOLTAGE STRESS RELIEF INSTRUCTIONS
- 9. CONNECTORS ARE UL LISTED PER UL486A-B AND CSA CERTIFIED PER C22.2 NO.65 FOR POWER APPLICATIONS UP TO 90°C
- 10. CONNECTORS ARE UL LISTED FOR GROUNDING, BONDING, AND DIRECT BURIAL APPLICATIONS PER UL467
- 11. CONNECTORS ARE CSA CERTIFIED FOR GROUNDING, BONDING, AND DIRECT BURIAL APPLICATIONS PER C22.2 NO.41



			'BLE	O	PE	
NO.	ECN	DATE		₹1	T. I	229
	REVISIO		SEE	√)	EDIN	

- 1															
			Χ		COPPER TUBING										
Ī	Q	TY.		PT.	NA	ME OR	DE	SCRIPTI	ON						
					PE										
					for										
					1/0 AWG COPPER CONDUCTORS										
					REF. DWG'S: 2H03-45257, 2H03-3139	2591	H:\2H	03\BL	U-1.0S						
						DRAWN E	3Y:	DT	DATE: 2/2	2/2023	CHK'D:	QJB			
			些	<u>.</u>	PENNÜNION™	SCALE: 2	:1	INTERPRE	T PER ASME	Y14.5-2009	FILE:	2H03			
			[ABI	Ž.		SIZE: B	G.		DIII	1 /00		REV.			
			SEE 1	CAT	229 WATERFORD STREET EDINBORO, PA 16412 USA	$\oplus \Box$	Š	O	BLU-	1/05		_			
			_ •		•										