




USE BELOW OPTIONAL SUFFIXES FOR ALTERNATE LUG CONFIGURATIONS:

- -45 FOR 45° BENT PAD
- -90 FOR 90° BENT PAD
- -FL FOR FLARED BARREL ENTRY
- -U FOR UNDRILLED PAD EXAMPLE: BLU-8\$15-FL



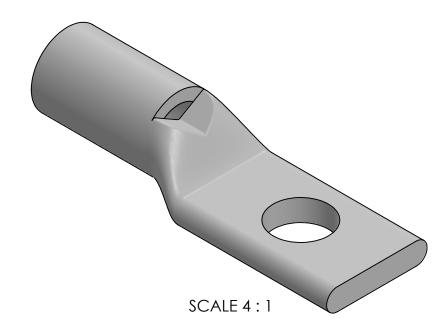

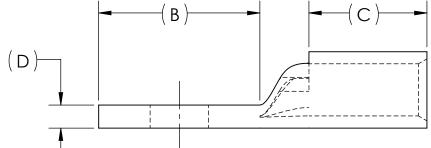



NOTES:

- ALL DIMENSIONS IN INCHES UNLESS OTHERWISE SPECIFIED
- SEE INSTALLATION SHEET FOR WIRE SIZE AND TOOLING RECOMMENDATIONS
- TIN-PLATED TO INHIBIT CORROSION
- RATED FOR COPPER CONDUCTORS ONLY
- BEVELED ENTRY FOR EASY CABLE INSERTION
- INSPECTION WINDOW TO ENSURE FULL CABLE INSERTION 6.
- 7. CONNECTORS ARE SUITABLE FOR VOLTAGES UP TO 35 KV
- FOR APPLICATIONS GREATER THAN 2000 VOLTS, CONSULT CABLE MANUFACTURER FOR VOLTAGE STRESS RELIEF INSTRUCTIONS
- CONNECTORS ARE UL LISTED PER UL486A-B AND CSA CERTIFIED PER C22.2 NO.65 FOR POWER APPLICATIONS UP TO 90°C
- 10. CONNECTORS ARE ULLISTED FOR GROUNDING, BONDING, AND DIRECT BURIAL **APPLICATIONS PER UL467**
- 11. CONNECTORS ARE CSA CERTIFIED FOR GROUNDING, BONDING, AND DIRECT BURIAL APPLICATIONS PER C22.2 NO.41



| | | | QTY. | | PT. | NAME OR DESCRIPTION | | | | | | |
|--|--------------|---|------|-------|-----|--|------------|--------|-------------------------|--------|------|--|
| | | | | | | PENN-CRIMP LUG | | | | | | |
| | | | | | | for | | | | | | |
| | | | | | | 8 AWG COPPER CONDUCTORS | | | | | | |
| | | | | | | REF. DWG'S: 2H03-35679, 2H03-35680 H:\2H03\BLU-8 | | | | 3S | | |
| | | | | | | | DRAWN BY: | : DT | DATE: 2/22/2023 | CHK'D: | QJB | |
| | | | | 삗 | o. | PENNŮNION [®] | SCALE: 3:1 | INTERP | RET PER ASME Y14.5-2009 | FILE: | 2H03 | |
| | NO. ECN DATE | 1 | | TABLE | | | SIZE: B | · . | | | REV. | |
| | REVISIONS | 1 | | SEE . | CAT | 229 WATERFORD STREET EDINBORO, PA 16412 USA | ⊕⊟ 2 | | BLU-8S | | - | |
| IND IS TO BE USED SOLELY FOR THE DURDOSE FOR WHICH IT IS EURNISHED AND MUST BE DETURDED. | | | | | | | | | | | | |

COPPER TUBING